

DATA SHEET. Model: MBA-150-3.

Self-contained emergency luminaire with non-maintained functioning of the Polar Autotest Series.




Description

Self-contained emergency luminaire with Autotest function for flush mounting.
Composed by three modules: luminaire, kit and battery.
Illumination through LED crown (possibility of warm temperature color: 3,000 K).
Minimalist design with transparent, soft opal (-8%) or strong opal (-30%) diffuser.

Technical characteristics


Lamp in emergency	6 x LED White 5,700 K
Lamp in maintained	No
Flux in emergency	150 lm
Flux in maintained	No
Charge/fault indicator	1 x LED bicolor (green and red)
Autonomy	3 h
Supply voltage	230 Vac - 50 Hz
Operation temperature	0 ÷ 40°C
Mains power	2.0 W
Battery	Ni-Cd (HT) 3.6 V – 1.5 Ah
Remote controllable	Yes (TL-300)
Protection rating	IP42 - IK08 (IP55 possible)
Electrical insulation	Class II
Applicable legislation	CE marking (93/68/CEE): 2014/35/EU 2014/30/EU 2011/65/EU

Photometric curve

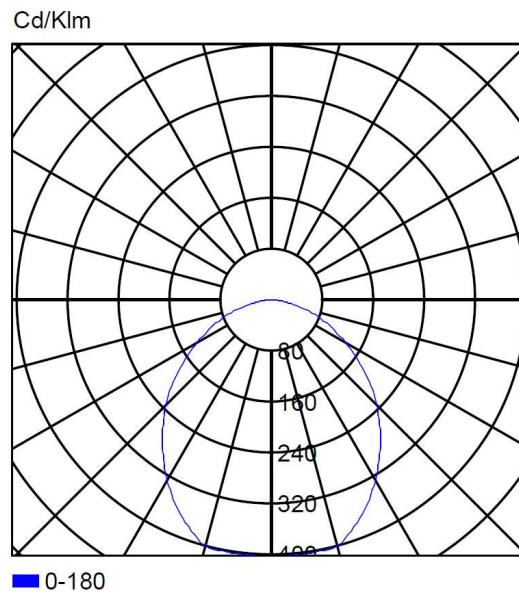

Dimensions

Flush mounting

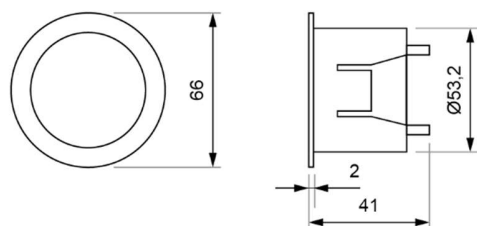

DATA SHEET. Model: MBA-150-3 _ Rev. 01 (March 2024)



LUZNOR Desarrollos Electrónicos, S.L.
Paduleta, 47 · 01015 · Vitoria-Gasteiz · 945 200 961
NIF: B01266451 · luznor@luznor.com · www.luznor.com



Autotest function

Each emergency lighting device checks continuously the status of the battery and the electronics in mains presence and performs two types of different tests automatically:

Test	Check	Duration	Frecuency
Funcional	Lamp, electronics and battery	6 min	3 months
Autonomy	Lamp, electronics, battery, and autonomy	1, 2 or 3 h	12 months

In case of failure, this is indicated on the device through a charge indicator LED turning on red, both when the device is connected to the mains and when it is in emergency mode.

After solving the failure, the *reset* button must be pressed during 3 seconds to inform the device of its restoring.

