

---

**DATA SHEET. Model: PHA2-2000PE.**

---

Self-contained emergency floodlight with maintained functioning of the PH Autotest Series.



---

**Description**

---

Emergency floodlight with Autotest function for surface mounting.

Small-sized metal body with epoxy paint in RAL 7035 grey colour: watertight wall cabinet with lockable door.

Four fully adjustable LED spotlights, with concentrated light beam, ideal for great heights.

Supplied with a PG-11 cable gland for cable entry from the side.

---

**Technical characteristics**

---


Lamp in emergency	4 x LED White 5,000 K
Lamp in maintained	4 x LED White 5,000 K
Flux in emergency	2.000 lm
Flux in maintained	2.000 lm
Charge/fault indicator	1 x LED bicolor (green and red)
Autonomy	2 h
Supply voltage	230 Vac - 50 Hz
Operation temperature	0 ÷ 40°C
Mains power	17.0 W
Battery	Ni-Cd (HT) 12 V - 4 Ah
Remote controllable	Yes (TL-300)
Protection rating	IP66 - IK08
Electrical insulation	Class I
Applicable legislation	CE marking (93/68/CEE): 2014/35/EU 2014/30/EU 2011/65/EU

---

**Photometric curve**

---

Cd/Klm

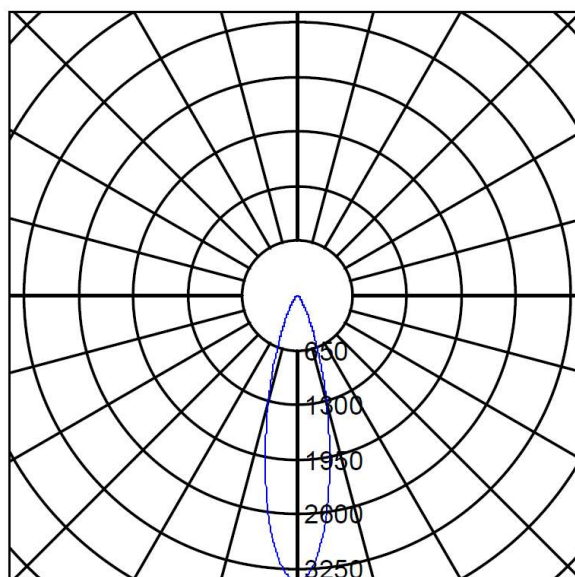

■ 0-180

---

DATA SHEET. Model: PHA2-2000PE \_ Rev. 01 (March 2024)




**LUZNOR Desarrollos Electrónicos, S.L.**  
Paduleta, 47 · 01015 · Vitoria-Gasteiz · 945 200 961  
NIF: B01266451 · luznor@luznor.com · www.luznor.com



## Dimensions

Surface mounting

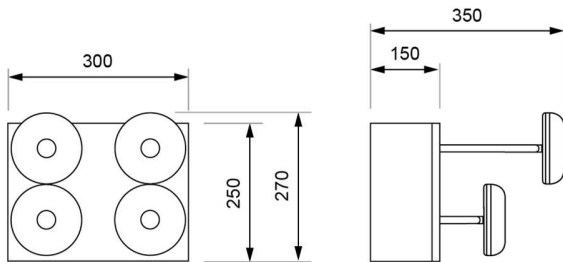













## Autotest function

Each emergency luminaire checks constantly the battery status and the electronics in the presence of mains power and performs automatically two types of different tests:

Test	Verification	Duration	Frecuency
Functional	Lamp, electronics and battery	6 min	3 months
Autonomy	Lamp, electronics, battery, and autonomy	1, 2 or 3 h	12 months

In case of failure, this is indicated on the emergency luminaire by a red LED, whether the luminaire is connected to mains or in emergency mode.

After solving the fault, the *reset* button must be pressed during 3 seconds to inform the luminaire that it has been restored.

	— —	1 flash.....	Lamp failure	
		—	2 flashes.....	Battery failure
			3 flashes.....	Electronics failure
		Flashing and lamp off.....	Charging battery (24 h)	
		Flashing and lamp on.....	Performing any of the tests	
		On permanently and lamp off.....	Charging and on alert	

DATA SHEET. Model: PHA2-2000PE \_ Rev. 01 (March 2024)



**LUZ NOR Desarrollos Electrónicos, S.L.**  
 Paduleta, 47 · 01015 · Vitoria-Gasteiz · 945 200 961  
 NIF: B01266451 · luznor@luznor.com · www.luznor.com

